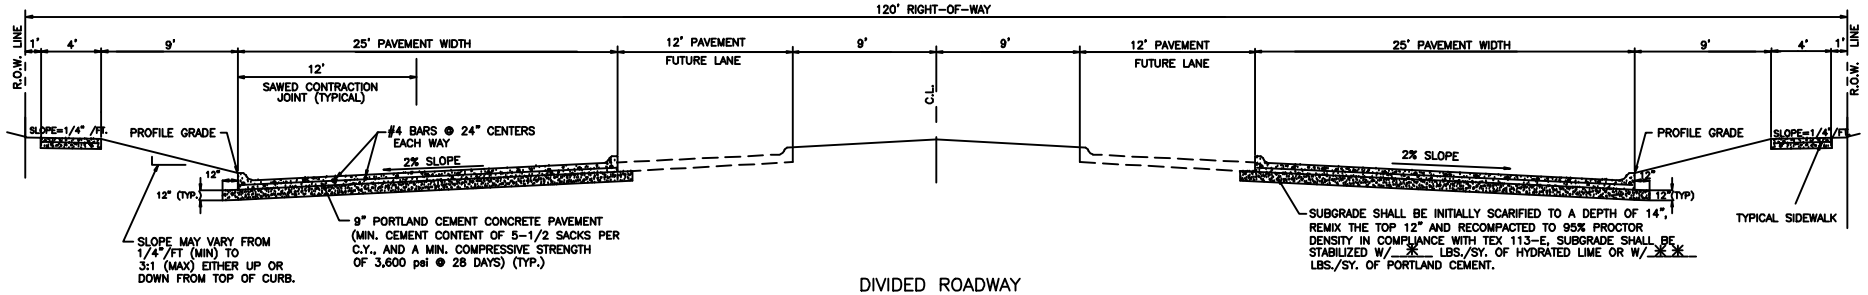

DIVIDED ROADWAY
(120' RIGHT-OF-WAY)
NTS

NOTES:

1. TRANSVERSE SAWED CONTRACTION JOINTS AT 15' INTERVALS AND LONGITUDINAL SAWED CONTRACTION JOINTS 12' FROM OUTSIDE BACK OF CURBS.

* 2. LIME SHALL BE APPLIED AT 6% BY WEIGHT MINIMUM QUANTITY IS 54#/SY. IN SOME AREAS A GREATER QUANTITY (OR A LIME SERIES TEST) MAY BE REQUIRED AT THE CITY'S DISCRETION.

** 3. CEMENT SHALL BE APPLIED AT 5% BY WEIGHT. MINIMUM QUANTITY IS 45#/SY.

REVISIONS	
REVISIONS	Revised 11/16/99 (Bar Sizes & Pavement Layer Thicknesses)

CITY OF ARLINGTON, TEXAS

PROJECT NUMBER
PROJECT NAME
(PROJECT LIMITS)

DATE:	SCALE:	SHEET ___ OF ___
DESIGNED BY:	DRAWN BY:	CHECKED BY: