


PLAN

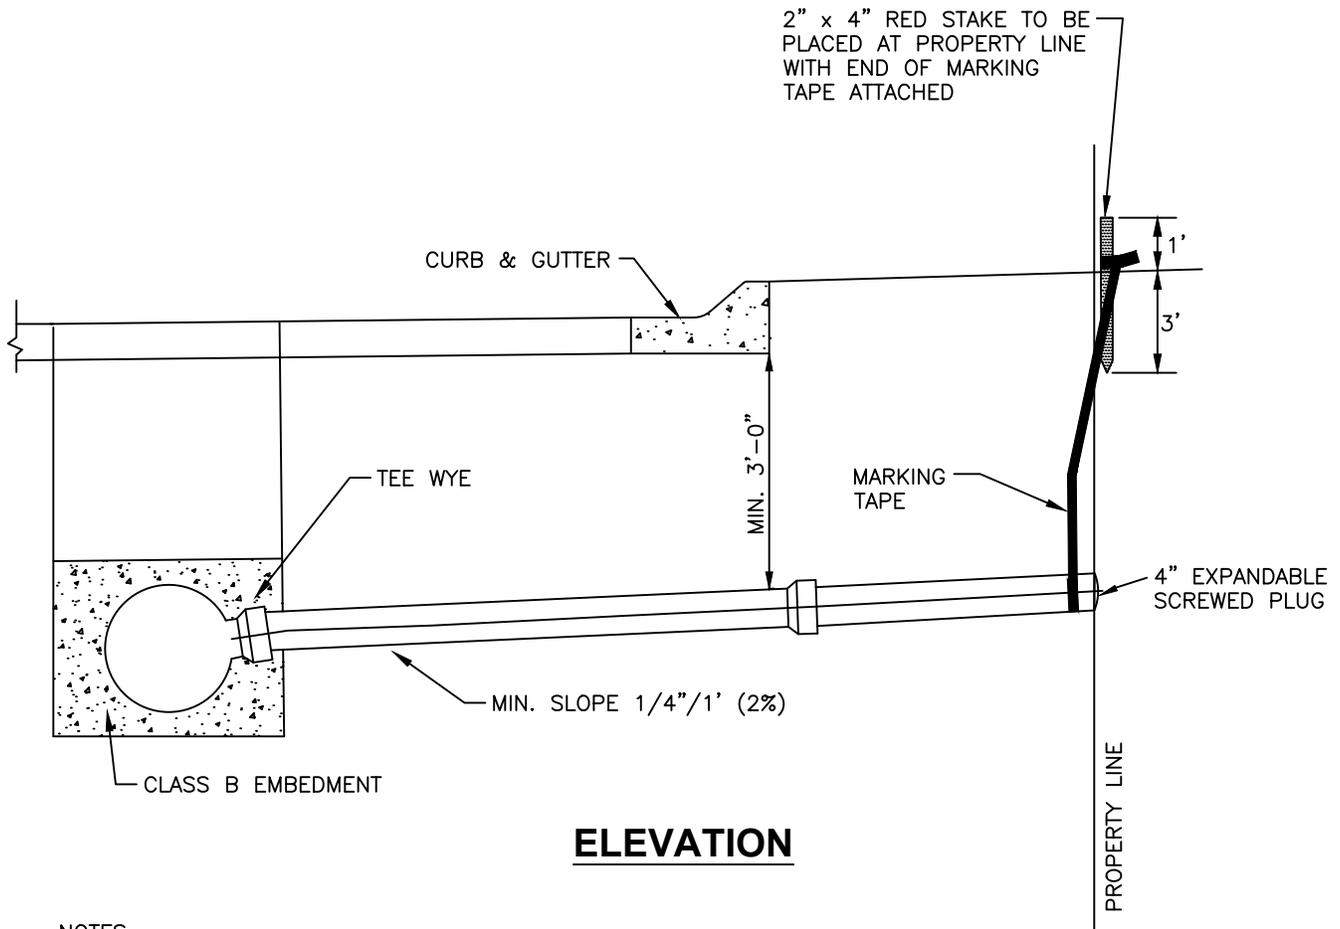

ELEVATION

NOTES:

1. SERVICES WITH LESS THAN 2' CLEARANCE UNDER AN EXISTING OR PROPOSED STORM DRAIN REQUIRE CONCRETE ENCASEMENT OR STEEL CASING.
2. SERVICES SHALL BE SDR-26 PVC PIPE WITH CLASS B EMBEDMENT.
3. NEW SERVICE TAPS ON EXISTING MAINS REQUIRE INSERTA-TEE CONNECTION OR APPROVED EQUAL.
4. SERVICES 8" AND LARGER REQUIRE A MANHOLE TO CONNECT TO MAIN. UNLESS OTHERWISE APPROVED BY WATER UTILITIES.

CITY OF ARLINGTON, TEXAS
SANITARY SEWER SERVICE
DATE: 11/19/2018