




CUT AS REQUIRED FOR  
6, 8, 10, 12 INCH PIPE  
ALONG CUTTING GROVE



DETAIL A  
N.T.S.



DETAIL B  
N.T.S.

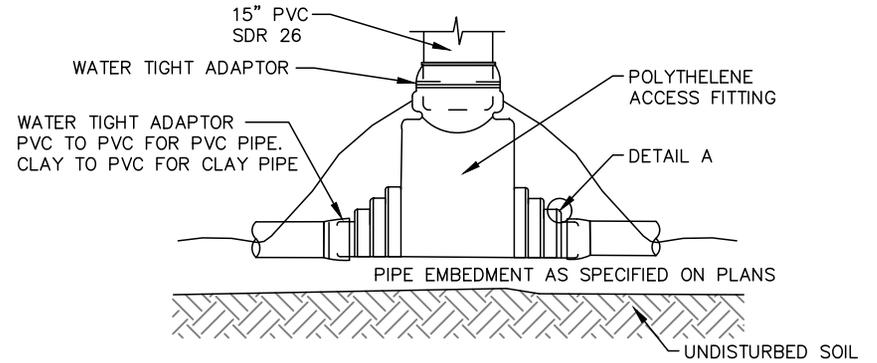


SECTION A-A  
N.T.S.

STANDARD 24" CAST IRON  
MH FRAME & COVER  
PER SPECIFICATION

PAVEMENT  
SEE NOTE 1

CLEARANCE:  
4" MIN 8" MAX

EX GROUND

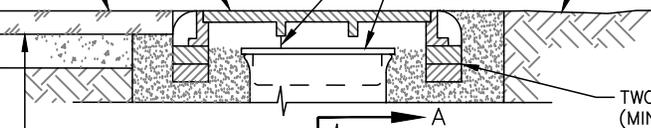

TWO CONC GRADE RINGS  
(MIN) & NON-SHRINK GROUT

VARIES  
(MIN 16")

15" PVC PIPE  
ASTM D 3034  
(SDR 26)

UNDISTURBED SOIL

FLOWABLE FILL

26"

6" MIN

6" MIN

POLYETHYLENE  
ACCESS FITTING

1" WASHED CRUSHED  
STONE

UNDISTURBED  
SOIL

EQUAL TO  
PIPE BEDDING

NOTES:

1. ALL ACCESS CHAMBERS SHALL BE INSTALLED WITH A 5'X5' CONCRETE PAD WITH COVER IN CENTER OF PAD. THE CONCRETE PAD SHALL MATCH PAVEMENT THICKNESS WITHIN PAVEMENT, OR 6" THICK OUTSIDE PAVED AREAS
2. PADS SHALL BE REINFORCED WITH FOUR NO. 4 REBARS.



CITY OF ARLINGTON, TEXAS

SANITARY SEWER  
ACCESS CHAMBER

DATE: 01/09/2018